# **ELSAFE INDIA**

Leading The Way To Safey

Cochin - Chennai - Bangaluru - Hyderabad - UAE

ALL INDIA TOLL FREE NUMBER 1800-121-9092

www.elsafeindia.com, info@elsafeindia.com Ph No: 0484-2575199-210, Fax: 0484-2575211







Project Name: TEK 500 PKG

**Quote #:** 12121Teksai Budget Pkg **Company:** Residential-Total Protection



These are Residential Packages for Houses at Kerala State only, ALL KERALA FREE DELIVERY, NO HIDDEN CHARGES, FIXED RATE

Revision:

Terms: \*\*\*

Ship via: Land Cargo FOB: Ex-Factory Weight: \*\*\* As applicable

#### Coverage -15 mtr radius

TE	KSO 500							
Number	Item	Description	Qty.	Unit	nit Unit Cost		Total Cost	
		Lightning Protection System			(ir	i INR)	(ir	INR)
1	LA TERMINAL	TeksoPrevent MODEL: TEK500 (Lightning Arrestor) Supply of Lightning arrestor Tekso Prevent Air terminal which is a Copper built lightning arrestor. 1. Large protection region; High performance 2. High quaity 3. Strong anticorrosion and conductivity	1	no	INR	13,750	INR	13,750
2	Earthing	Model: TEKSAI Copper bonded rod 2 Nos Spec: 2 Mtr Length x 14.2 mm dia x250 micron (ISO 9001-2008 Certified Company), CPRI Approved, Maintance free Earthing. Model: TEKSAI ELECTRON - High Conductive Concrete (High Conductive & Anti Corrosive Compound) Application: Superior Choice & Reliable Performance for all Soil / Sandy / Rocky / Filled sand location ELECTRON 25 kgs	1	No	INR	5,000	INR	5,000
3	Down conductor	25X3 GI STRIP	25	Mtrs	INR	120	INR	3,000
4	mast section	Specially designed 3mtr GI mast, 1Feet FRP Mast with LA Base, adaptor and Accessories	1	set	INR	5,000	INR	5,000
5	Installation	Installation of Lightning Protection System	1	Job	INR	5,000	INR	5,000
Quotation Valid For 20 days GRAND TOTA			ΓAL	INR 3	1,750.00			

#### Terms & Conditions

- GST Extra if Applicable 1
- 2 Customers Scope: Material safety will be customer scope after delivery
- Height arrangement -customer scope. EXTRA STRIP woulb be charged at 130/Mtr 3
- Pit digging-Normal soil condtion only. Extra fitting /work charged extra 4
- Approvals /Permission of work/storage of tools & equipment/safety/ etc : At customers scope 5
- PVC pipe to be provided by Customer as required/will be puchased and billed seperately by our service engineer. 6

Thank you,

Best Regards


**ELSAFE PROTECTION & CONTROL SYSTEMS** 

Ph No 0484-2575199

Doc. No.: ES20210407

Rev. No.:

Rev. Date :

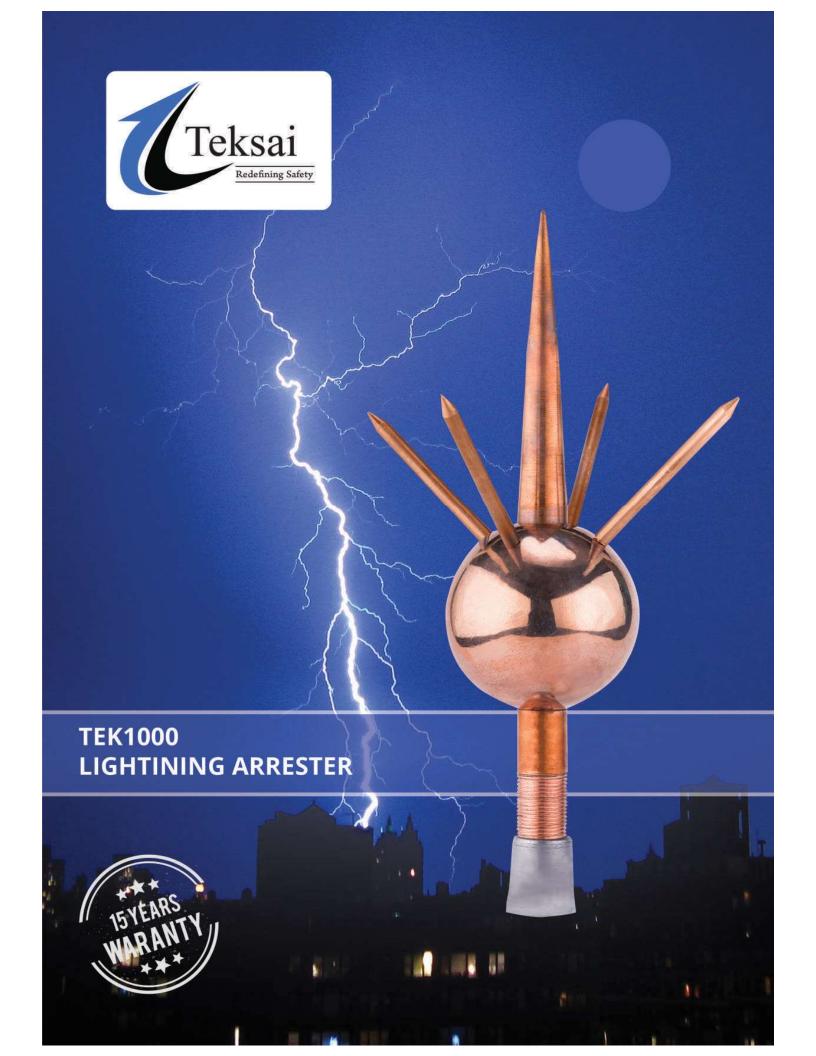



PROTECTION LEVEL	EFFECTIVENESS OF LIGHTNING CONDUCTOR E
1///	0.98
11	0.95
111	0.90
IV	0.80



Particulars	Specification
Material	Copper
Air Rod Height	300 MM
Air Rod Diameter	100 MM
Protection Angle	65°
Corresponding Protection Radius	2.14 h
Max Impulse Current Discharge	50 KA
Average Discharge Current	25 KA
Current Gradient Less Than	40KA
Grounding Resistance	Less Than 10 Ohm
Resistible Wind Speed	Over 50m/s














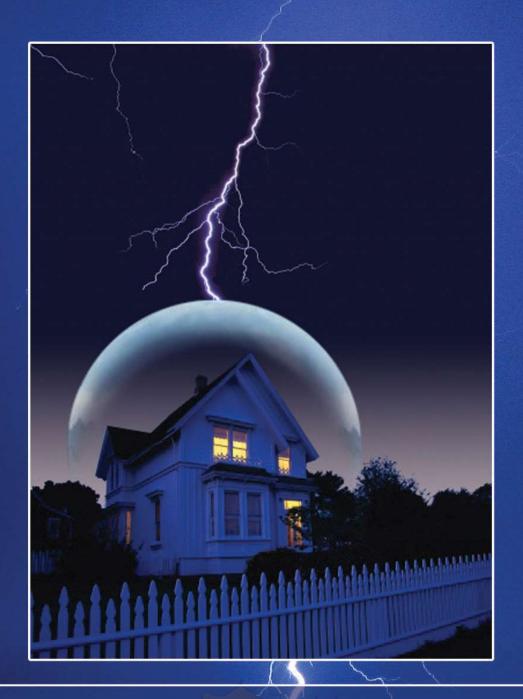

www.teksaiearthing.com

Marketing office kerala

ELSAFE PROTECTION AND CONTROL SYSTEMS D10-4/60, Densons Building Marottichodu, Edapally, Cochin, Kerala Ph No: 0484 - 2575199 info@elsafeindia.com www.elsafeindia.com

Distributor / Dealer

#### **Blue Star Industries**

Kanjikode West Palakkad-678623 Kerala, India Ph no: 0491-2803511-521



# **Certificate of Quality**

#### **Test Details**

Serial Number	: 16021025	Volume resistivity, IEC60093	: 1E13/1E9 Ω*m
D 1 1 1 1 1		Surface resistivity, IEC60093	: * / 1E10 Ω
Product Name	: TEKSOPREVENT	CTI, solution A, IEC60112	: 600
		Mechanical properties	
Model Number	: TEK1000	Tensile modulus, ISO527-2	: 3500/1500 MPa
		Yield stress, ISO527-2,	: 75/45 MPa
Date	: 03-28-2016	Yield strain, ISO527-2,	: 4/20 %
		Strain at break, ISO527-2	: 6/250 %
Technical specification		Charpy V-notch impact strength,-ISO179/1e	U : 80/N kJ/m2
Melting temperature,	: 1001 °C	Technical specification of Ball Enclosure	1
ISO3146 Density, ISO1183	: 1.16 g/cm3	Durometer Range A	: 25 -85
Melt volume rate MVR 275/5,	: 140 cm3/10 min.	Tensile, Max. psi ( Mpa )	: 1300 lbF (10.5kN)
ISO1133 Molding shrinkage, Test	: 0.8%	Elongation, max %	: 800
box 1.5mm Moisture absorption,		Specific Gravity	: 1.1
equilibrium-23°C/50% r.h. ISO62	: 2.6 – 3.2%	Continuous Temp Max	:800 °C
Thermal properties		Compression set	: Excellent
Deflection temperature 1.8MPa, ISO75-2	: 800 °C	Environmental and Immersion Properties	3
Deflection temperature 0.45 MPa, ISO75-2	: 1600 °C	Electrical Resistivity	: Excellent*
RTI electrical ( thickness 1.5mm ), UL746B	: 1050 °C	Flame Resistance	: Good*
<u>Flammability</u>		Impact resistance	: Good*
UL94 rating	: V-0 ( >=0.4 )	Tear Resistance	: Fair
Hot wire ignition, ASTM D 3874-	: 2 ( >=1.5 )	Continuous Temp Max	: 1472 °F
88 High current arc ignition,	: 0 ( >=0.4 )	Intermittent Temp Max	: 1122 °F
UL746A,Fire/ignition performance-		Weather change tolerance	: Excellent*
( UL94+HAI+HWI ), UL746C	: 1.5 mm	Oxidation Resistance	: Excellent*
GWFI, IEC60695-2-12	: 1400 °F	Ozone Resistance	: C
GWIT, IEC60695-2-13	: 1350 °F	300°F Steam Resist.	: Good*
Limiting Oxygen index LOI ISO4589-2	: > 35 %	Temperature and Environment stress -	
Spec. optical density of smoke Ds,-		Screening tests	: Good*
25kW/m2, EN ISO5659-2	: 60	Salt water dipping test	: Good*
Conventional index of toxicity		UV test	: Good*
CIT, - 25kW/m2, EN ISO5659-2	:1	Vibration Endurance test	: Excellent*
Electrical properties		Impulse Current Test (40KA-240KA)	: Good*
Dielectric constant at 1MHz, IEC60250	: 3.6/6	(Equipment are tested only on one p	piece in a lot of 100 pieces*)
Dissipation factor at 1MHz, IEC60250	: 200/3000		,

Stamp & Signature

Kent

Head, Quality Control



# भारत सरकार Government of India राष्ट्रीय परीक्षण शाला (द.क्षे.) NATIONAL TEST HOUSE (SR)

347218

तरमणी, चेन्नई - 600 113. Taramani, Chennai - 600 113. Phone : 22432374, 22431157 Fax : 22433158 email : nthsr@tn.nic.in परीक्षण प्रमाण पत्र

# TEST CERTIFICATE

INTERIM/FINAL REPORT

पर्याणा प्रवाणा यहा स Test Certificate No. NTH(SR)/EL(C)/2014/00176A जारी होने की तिथि Date of Issue 23/04/2014

कोड नं Code No. 1396938243840

पुष्ठ Page

पर्व्या की संख्या No of Pages

जिसे जारी करना है **Issued To** 

TEKSAI POWER SECURE SOLUTION PVT.LTD.

पता

Address

3/860, BLUE STAR INDUSTRIES COMPOUND,

PUDUSSERY, KANJIKODE, PALLAKKAD, KERALA-678623

ग्राहक का सन्दर्भ सं एवं दिनांक

Customer's Ref. No.

TPSS/2014

Earthing material

Date: 25/01/2014

पंजिका सं एवं दिनांक

Register No & Date

00176/NTH(SR)/EL(C)/08/04/2014

परीक्षण सामग्री का विवरण

Description of Test Item

परीक्षण सामग्री का पहचान Identification of Test Item Printing marking on the bag:"Teksai-Ultra"

नम्ना का विशिष्टि (यदि ही) Product Specification (Flany)

Electrical Resistivity test as per customer's specification

नम्ना प्राप्ति की तिथि

Date of Receipt of the Test Item.

08/04/2014

कार्य सम्पादन की तिथि

Date(s) of Performance of Tests

From: 08/04/2014

23/04/2014

व्यावद्वत प्रणाली का पहचान

Method(s) used for Test

NA

नमना प्रकिया जहाँ प्रासंगिक ही

Sampling Procedure where relevant

**Tested By** 

N. Zorph Keley &c Natarajan Joseph kalaiselvan

SO Flectrical

Checked By

Electrical Resistivity test as per customer's specification

S.B. Nanda Kumar

SO Electrica

Scientist-SC(Electrical)

Approved By





P



4/9, Kirti Nagar Industrial Area, New Delhi-110 015 Tele: 011-45754575 Fax: 011-45754545 e-mail: arbrolab@arbropharma.com, Website: www.arbropharmaindia.com CERTIFICATE OF ANALYSIS

Sample :EARTHING BACKFILL COMPOUND Report No. :NR-11060906

Received On :09/06/2011

Mfg.Lic.No. : N.S.

Ref. No.

:N.S.

Submitted By : GENIUS PROTECTION SYSTEM. (P) LTD.

:248A, RATI COMPLEX, RAMA MKT., MUNIRKA, N DELHI. Address Mfg. Date

Batch No. N.S.

Supplied By : N.S.

N.S.

Expiry Date

Batch Size N.S.

Sample Qty

100GM.

### RESULTS OF ANALYSIS

Date of start of analysis 10-06-11 Date of Completion of analysis 13-06-11.

Description

:- Black powder.

<S1.No.> <Parameters> <Results> <Limit (MAX)>

B - TOXIC METALS

Mercury (as Hg) :- 0.251ppm 1.

1000.0ppm

2. Lead(as Pb) :- 8.225ppm 1000.0ppm

3. Cadmium (as Cd) :- 0.128ppm 100.0ppm

4 .

Hexa-Chromium(as Cr):- Less than 1.0ppm

1000.0ppm

Remark :- Observed value for Pb, Cd, Hg & Cr+6 are very low from the max limit, Hence sample complies the ROHS.

REMARKS : PARTY ASKED FOR THE ABOVE TESTS ONLY

Page

Person In Charge

Date: Monday, June 13, 2011



### CENTRAL POWER RESEARCH INSTITUTE (Member of STL)

Sheet 1 of 4

#### TEST REPORT

**Test Report Number** 

SC11376A

Dated: 29th August, 2011

Name & Address of the Customer

M/s. Teksai Power Secure Solution Pvt. Ltd., 3/860. Blue Star Industrial Compound, Pudussery, Kanjikodu, Palaghat, Kerala - 678 029,

Name & Address of the Manufacturer

M/s. Teksai Power Secure Solution Pvt. Ltd., 3/860, Blue Star Industrial Compound. Pudussery, Kanjikodu, Palaghat, Kerala - 678 029.

Particulars of sample tested Condition of the sample on Receipt GI Earthing Electrode

New.

Type
Designation
Serial Number(s)
Number of samples tested
Date (s) of test (s)
CPRI sample code no(s).

Teksal One 10<sup>th</sup> August, 2011 SC11S1323

Particulars of tests conducted

Test in accordance with Standard / specification Sampling plan Customer's requirement Deviations if any

Customer's instruction Not applicable 20 kA rms for 1.0 s

Short-Time current

...

Name of the witnessing persons

Customer's representative Other than customer's representative Mr. Praveen.P.V Mr. Jacob George

Test subcontracted with address of the laboratory

None

Documents constituting this report (in words)

Number of sheets Four Number of oscillograms One Number of graphs Nil Number of photos Two Number of test circuit diagrams One Number of drawings One

(N. Maheswara Rao) Test Engineer



AUTHORISED SIGNATORIES

(Swaraj Kumar Das) Joint Director



#### **Surge Protection Devices**


Made in France, EU

#### ALTERNATE CURRENT

# LSGBC50



#### APPLICATIONS



**Dimensions** 

- ●B+C class Surge Protective Device for AC Power System.
- Sensitive electronic equipment
- Telecom centers
- Automatic control centers
- Intelligent buildings
- Industrial enterprises
- Medical institutes

#### **FEATURES:**

- ●DIN rail mounting for easy installation
- ●Plug connectors for quick and easy connection or rewiring
- 50kA lightning impulse current Iimp
- ●Thermal disconnect device
- Status indicators visually verify protection level

#### **TECHNICAL PARAMETER:**

Model	LSGBC50
Electrical Parameter	
Nominal working voltage Un	50/60Hz 220/380V,
Max. continuous operating voltage Uc	385V
Nominal discharge current (8/20µs) In	50kA
Lightning impulse current(10/350µs) Iimp	15kA
Protection level @20kA, 8/20µs Up	2000V
Response time tA	100ns
Protection model	L1/L2/L3-N,N-PE
Mechanical characteristics	
Dimension	90 (H)×144 (W)×68(L)mm
Weight per unit	1200g
Mounting	35mm DIN rail
Connecting diameter	$\geq 10 \text{mm}^2$
IP code	IP20
Working conditions	Temperature: $-40$ to $80^{\circ}$ C,
	Relative humidity: ≤95%
Approval	FCC, CE, ROHS



### PHOENIX CONTACT GERMANY

# CTRL 1.5 Surge Arrester - Flashtrab FLT 35 CTRL 1.5



#### Features:-

- Lighting current arrester with encapsulated N-PE spark gap and ignition electronics
- 2 Channel Protection level 1.5 KV
- Housing width 40 mm (3 Div)

# Specification:-


Un 230 V

Uc 440 V, 260 V

Up ≤1.5 kV

Imp 100 kA

T\*C -40...+85

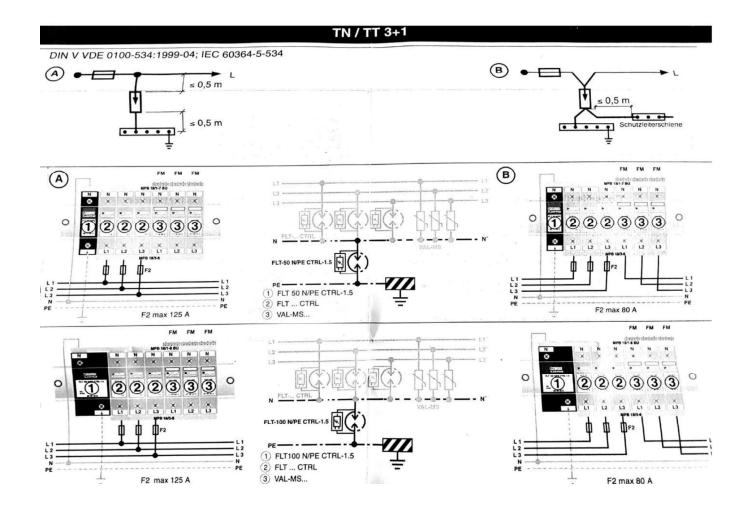

# Confirmation on quality assurance according to nuclear standard KTA 1401

On behalf of the German nuclear power plant operators, **E.ON Kernkraft GmbH** as a partner of the VGB PowerTech e.V. working group Assessment of Contractors confirms



# **Phoenix Contact Group**

valid for the sites

Phoenix Contact GmbH & Co. KG
Flachsmarktstraße 8, D-32825 Blomberg
Phoenix Contact Electronics GmbH
Dringenauer Straße 30, D-31812 Bad Pyrmont
Phoenix Contact Deutschland GmbH
Flachsmarktstraße 8, D-32825 Blomberg
Phoenix Contact Power Supplies GmbH
Oberes Feld 1, 33106 Paderborn

and the scope of supply and services

Design, manufacturing and sale of electrical and electronic connecting elements, power supply and surge voltage protection modules, as well as electronic interface systems

the qualification for system- and product related quality assurance.

The assessment was performed on April 20th and 21st, 2016 by

EUROCERT®

Gesellschaft zur Qualifizierung von Unternehmen mbH

based on the standard **KTA 1401** as well as on the assessment documents of the VGB PowerTech e.V. working group Assessment of Contractors in consideration of product related requirements.

Details of the assessment are given in the report Eurocert 2016/02.

This confirmation is valid until **March 08th, 2019** provided that the conditions on which the assessment was based have not been changed.

Hanover, April 29th, 2016

i.V. Blisraudel

EnBW









v.V.) 9 7

**E.ON Kernkraft GmbH** 



# Deutsche Akkreditierungsstelle GmbH

Entrusted according to Section 8 subsection 1 AkkStelleG in connection with Section 1 subsection 1 AkkStelleGBV
Signatory to the Multilateral Agreements of EA, ILAC and IAF for Mutual Recognition

# **Accreditation**



The Deutsche Akkreditierungsstelle GmbH attests that the calibration laboratory

Phoenix Contact GmbH & Co. KG Flachsmarkstraße 8, 32825 Blomberg

is competent under the terms of DIN EN ISO/IEC 17025:2005 to carry out calibrations in the following fields:

#### **Dimensional quantities**

#### Length

- Length measuring instruments
- Diameter
- Thread

#### **Electrical quantities**

#### DC and low frequency quantities

- Voltage
  - DC voltage
  - AC voltage
- Current
  - DC current
  - AC current
- DC resistance

#### Time and frequency

- Frequency
- Time interval

The accreditation certificate shall only apply in connection with the notice of accreditation of 24.01.2018 with the accreditation number D-K-12161-01 and is valid until 23.02.2020. It comprises the cover sheet, the reverse side of the cover sheet and the following annex with a total of 7 pages.

Registration number of the certificate: D-K -12161-01-00

Braunschweig, 24.01.2018

Dr. Heike Manke Head of Division Translation issued: 03.04.2018

Head of Division

This document is a translation. The definitive version is the original German accreditation certificate.





# CERTIFICATE

awarded to

Phoenix Contact GmbH & Co.KG Flachsmarktstr. 8 32825, Blomberg Germany

#### **DQS GmbH**

confirms, as an IRIS Certification™ approved certification body, that the Management System of the above organization has been assessed and found to be in accordance with the

# IRIS Certification™ rules:2017 and based on ISO/TS 22163:2017

for the activities of Design and Development and Manufacturing for the scopes of certification: 12 (Electrical wiring), 19 (Single railway components)

electromechanical and electrical connecting elements, plug connectors, surge voltage protection, cable assembly, tools and components for electrical engineering

Certificate valid from: 04/03/2018 Certificate valid until: 03/03/2021\*

Current date: 06/03/2018

Certificate-Register-No: 239330

la Heleh

Certification body address: August-Schanz-Straße 21, 60433 Frankfurt am Main, Germany

<sup>\*</sup> Providing that the subsequent surveillance audits are successful before the validity date of the previous audit.





Enclosure 1 of Certificate No.: 239330

### Phoenix Contact GmbH & Co.KG Flachsmarktstr. 8 32825, Blomberg Germany

### The location is supported by the following remote locations:

Address	Scope/Process
Phoenix Contact GmbH & Co. KG Bahnhofstr. 9 32816 Schieder-Schwalenberg, Germany	Logistics, Professional Education

Current date: 06/03/2018

Certificate-Register-No: 239330

Helen Heleh

<sup>\*</sup> Providing that the subsequent surveillance audits are successful before the validity date of the previous audit.